




High tension cables  
15,000 volts

+37.10  
Deposito de  
Villalba  
+34.60

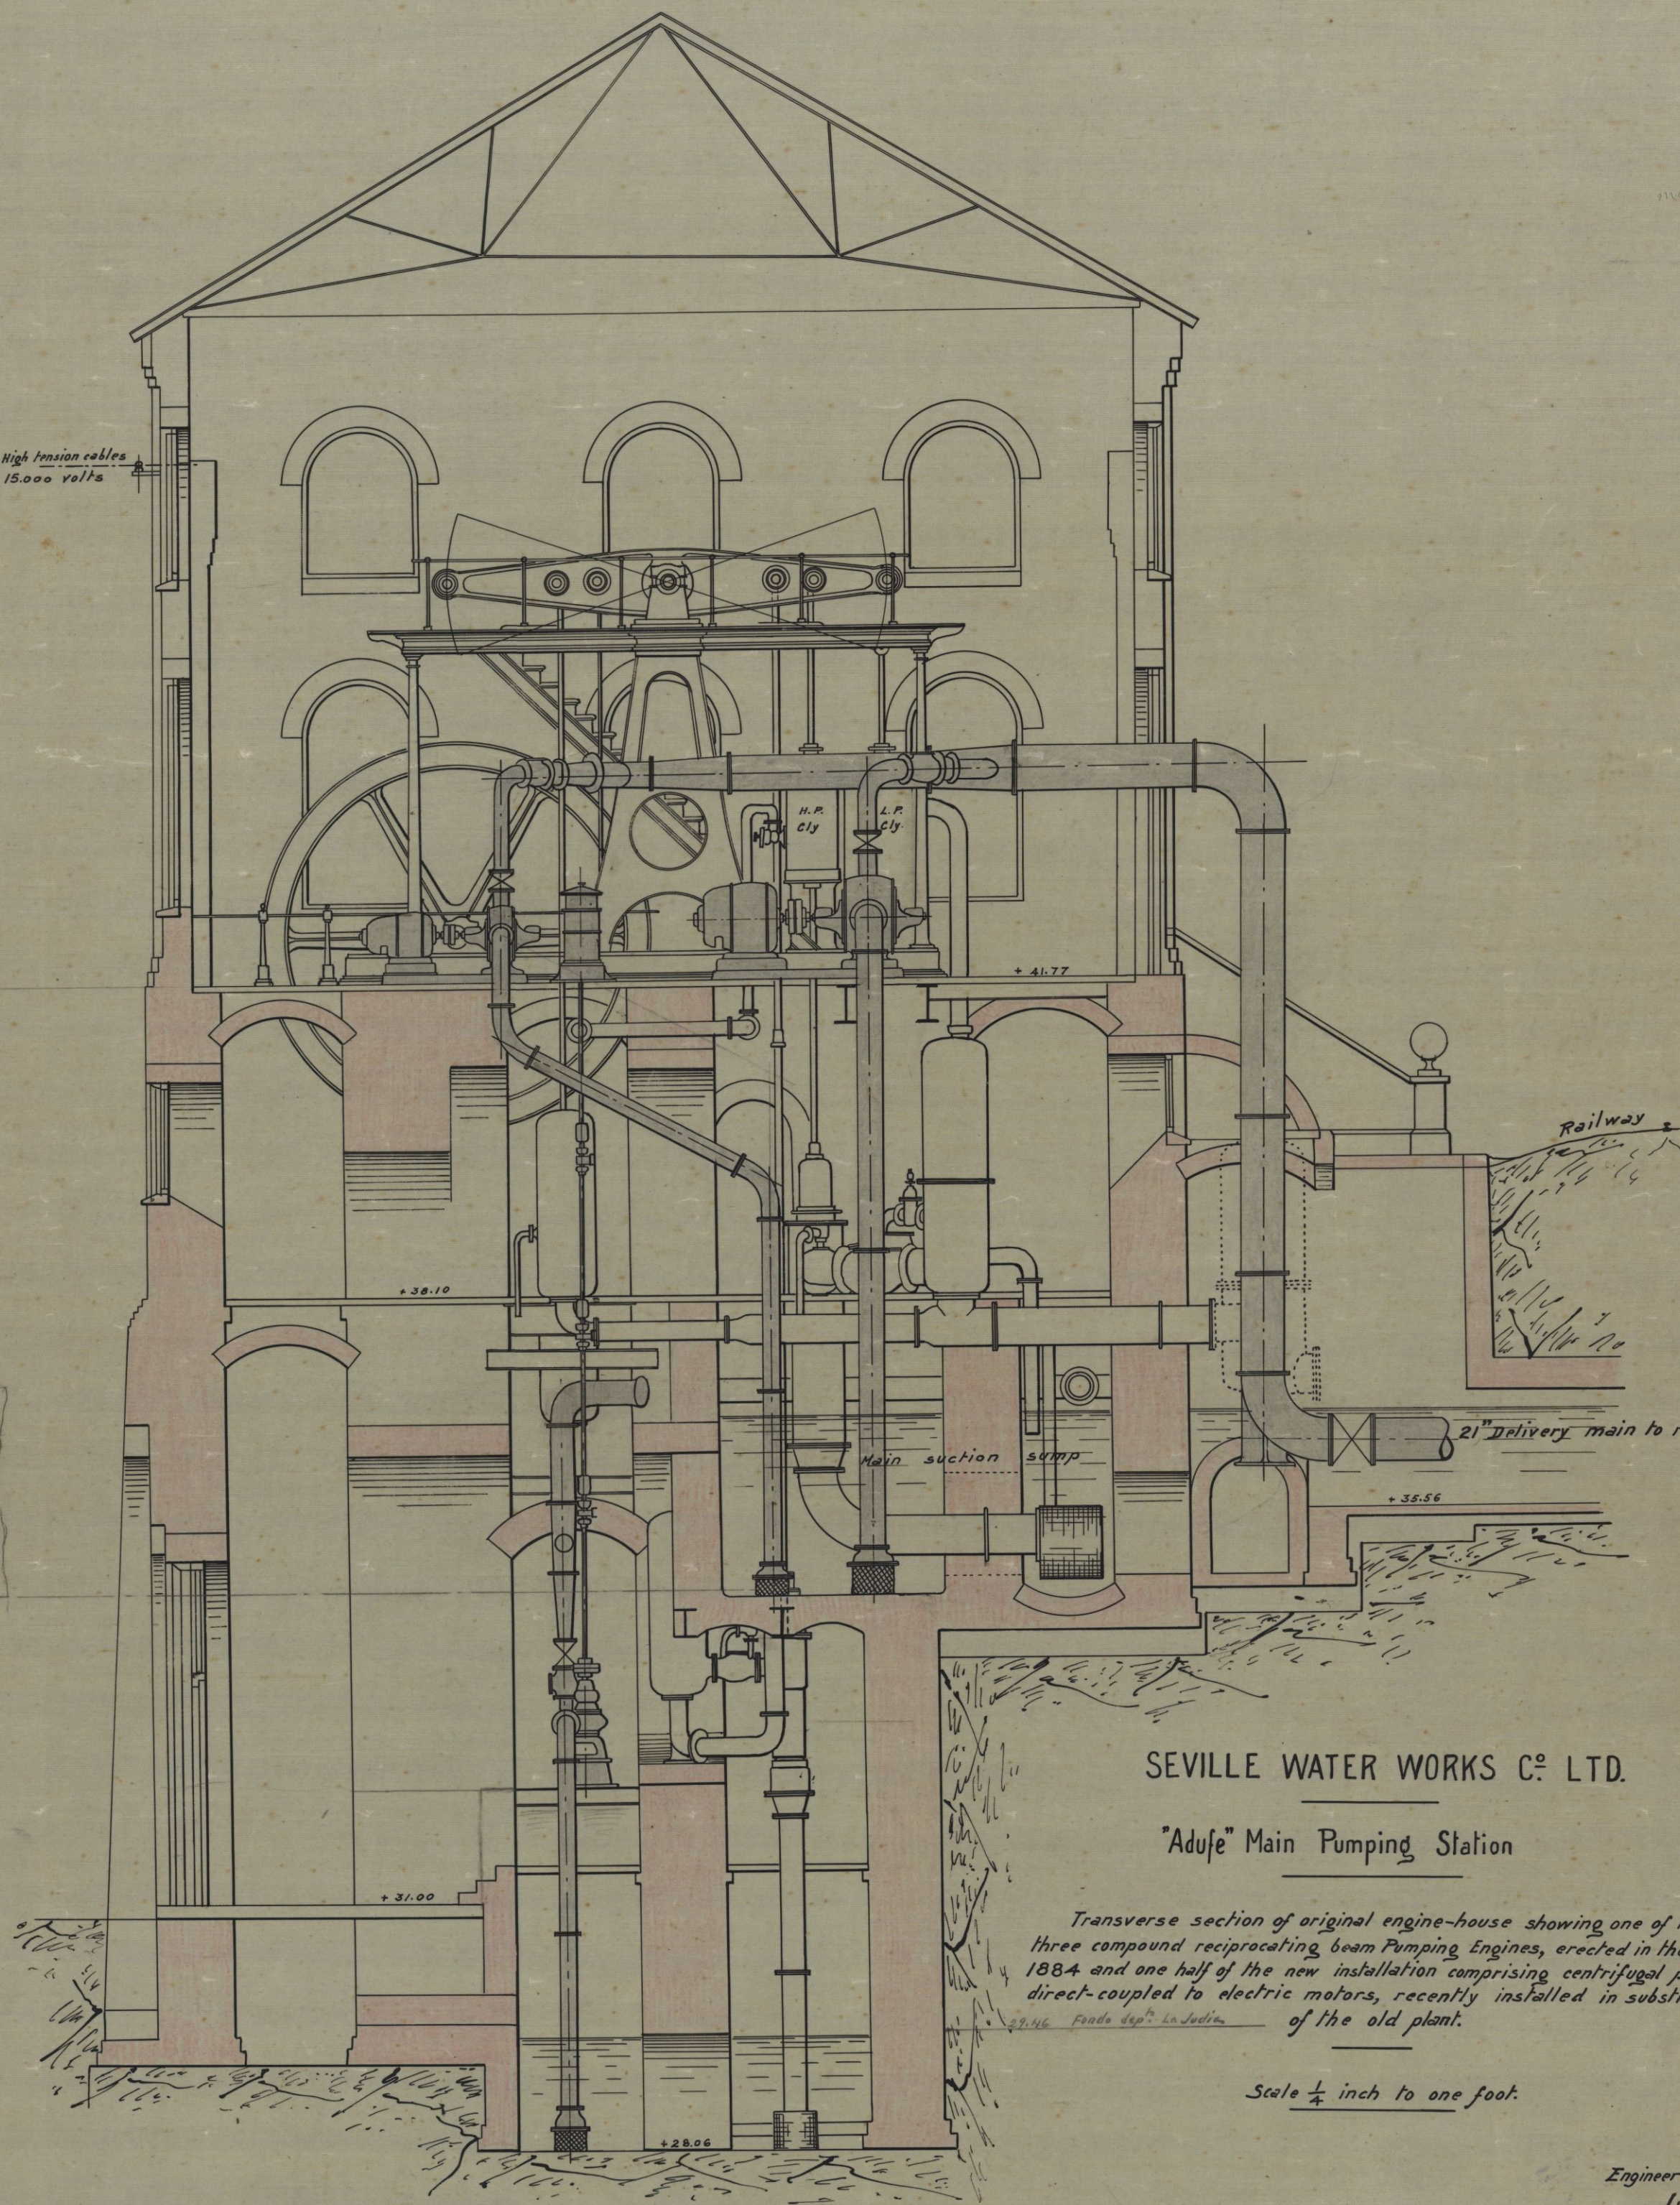

Railway

21" Delivery main to reservoir

SEVILLE WATER WORKS CO. LTD.

"Adufe" Main Pumping Station

Transverse section of original engine-house showing one of the three compound reciprocating beam Pumping Engines, erected in the year 1884 and one half of the new installation comprising centrifugal pumps direct-coupled to electric motors, recently installed in substitution of the old plant.

Scale 1/4 inch to one foot.

Engineer - Manager.  
W.P. Webb



PLANO N.º	ESTANTE	FILA	CASILLA
A.14	2.	1.	3.